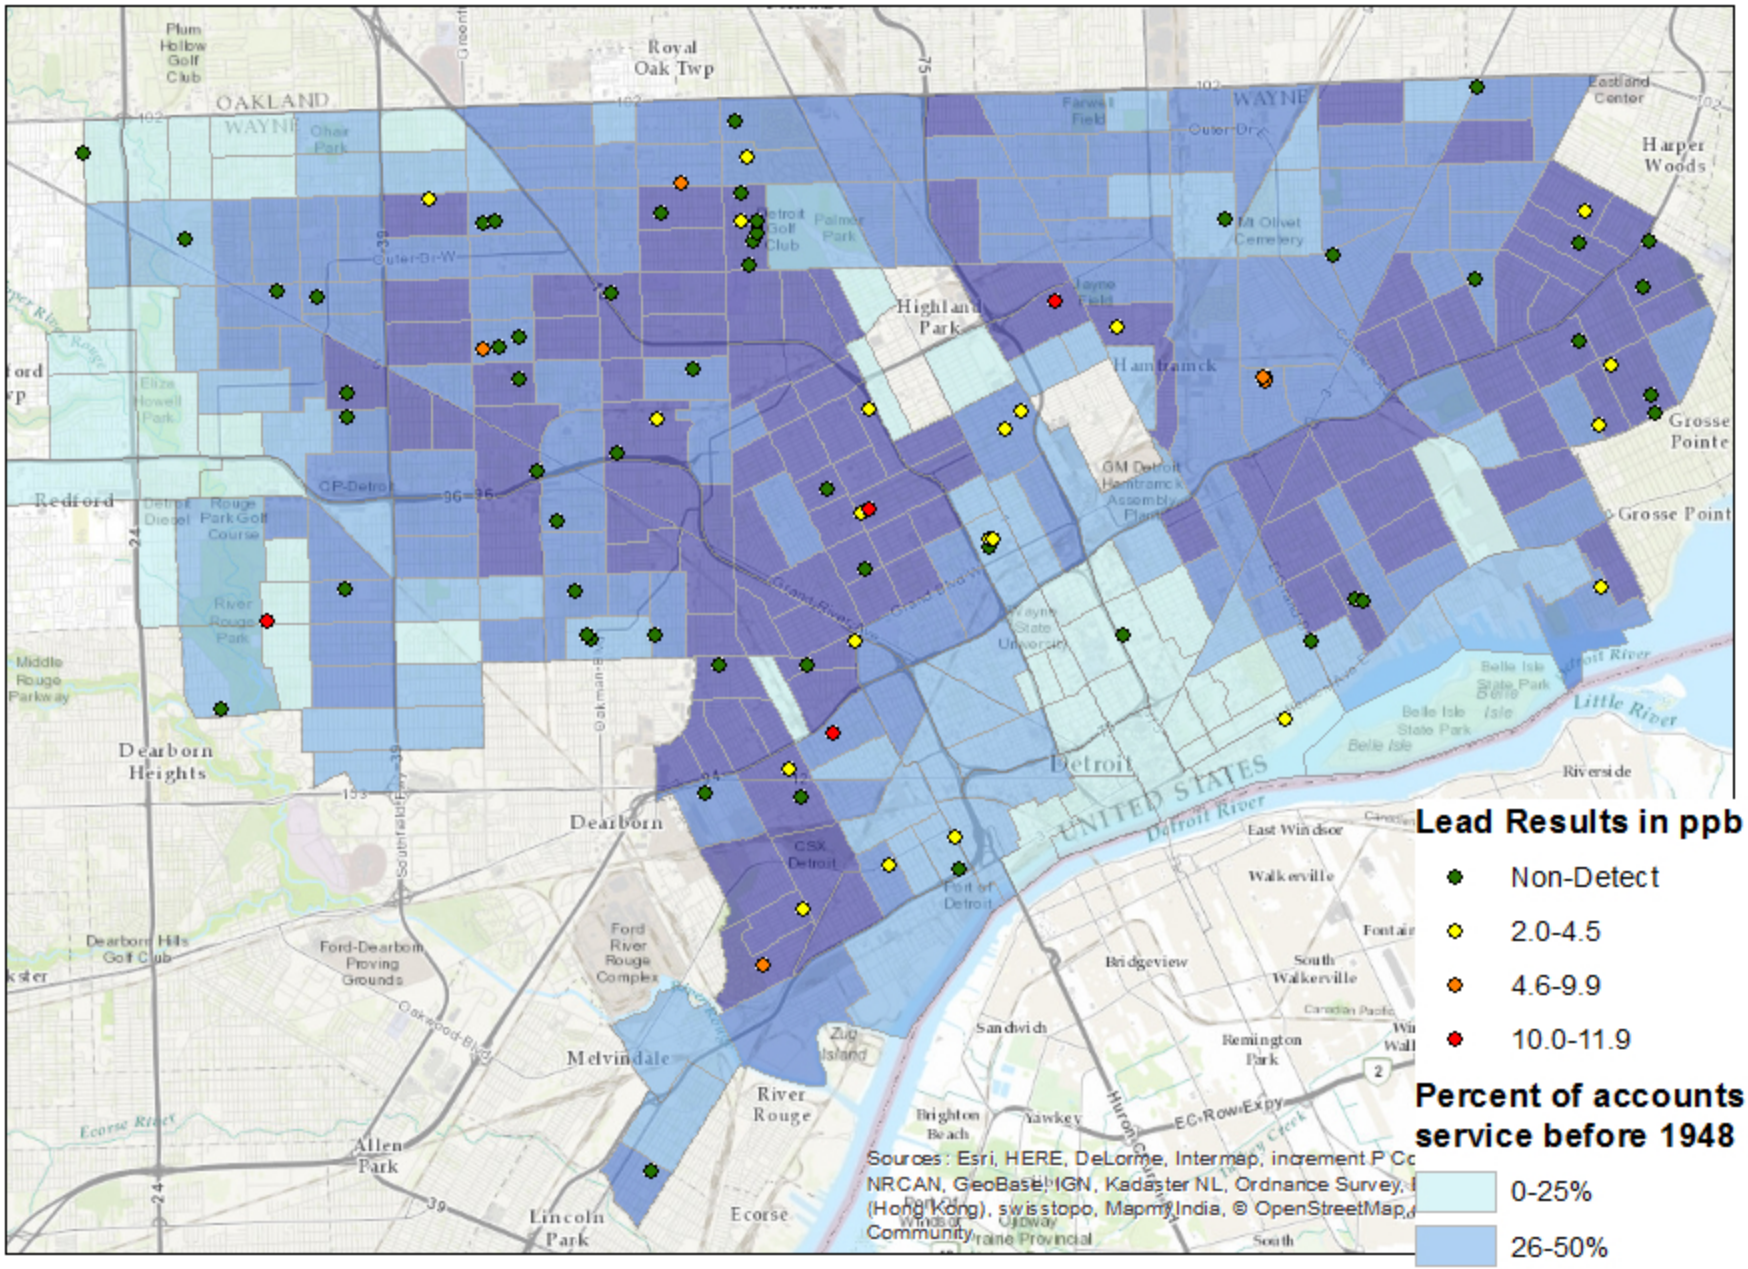DWSD 2016 Lead and Copper Rule Compliance Testing Sampling Results