



No overhang will be left




Any vegetation within 10' circumference of the outermost conductor

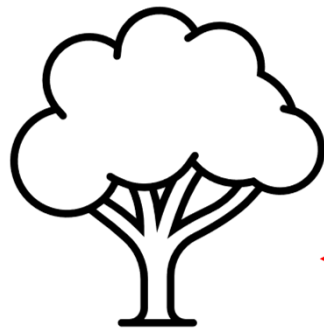

Attempt to remove all trees within 15' of either side of the pole that are <18" dbh, trim all trees that are not removed to provide 15' of clearance



Overhead View

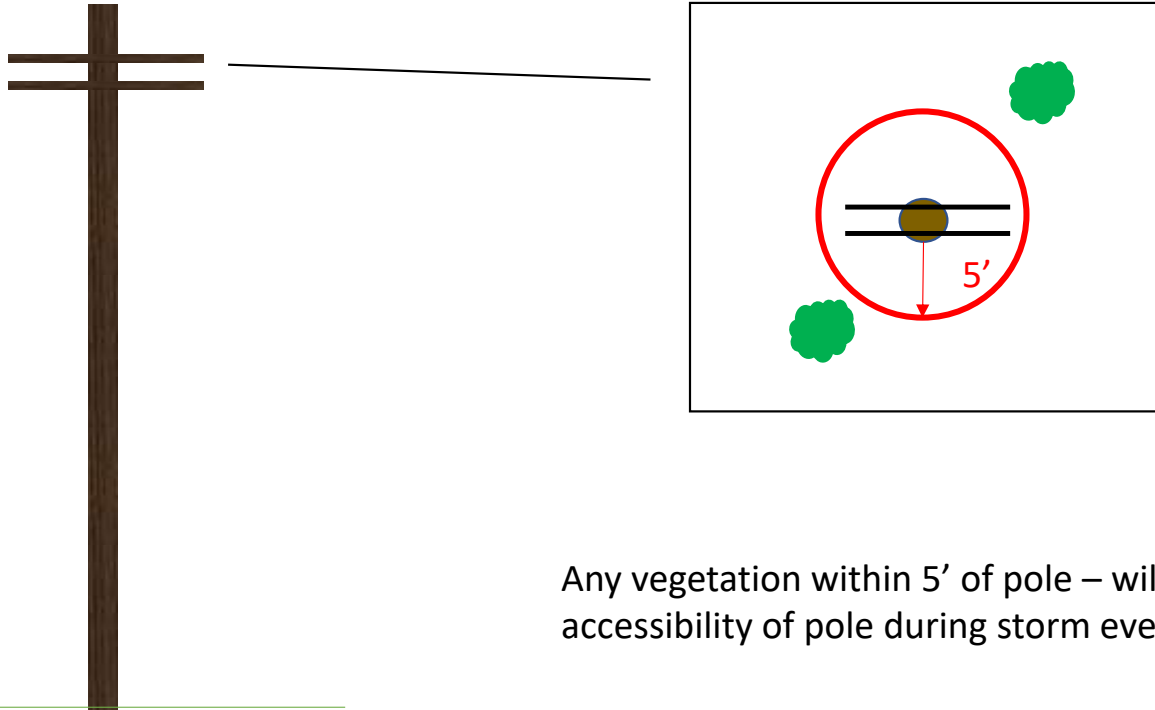

Any vegetation within 5' of pole – will request to remove for accessibility of pole during storm events or future upgrades