


DOUBLE-CHECK VALVE BACK-FLOW PREVENTION DEVICE

Whenever a residence has a secondary water supply, a double-check valve or other back-flow prevention devices meeting the approval of the Detroit Health Department will be required to be installed within 180 inches of the premises or where provisions are made for a Fire Department pumper supply to premises.

GROUND LEVEL

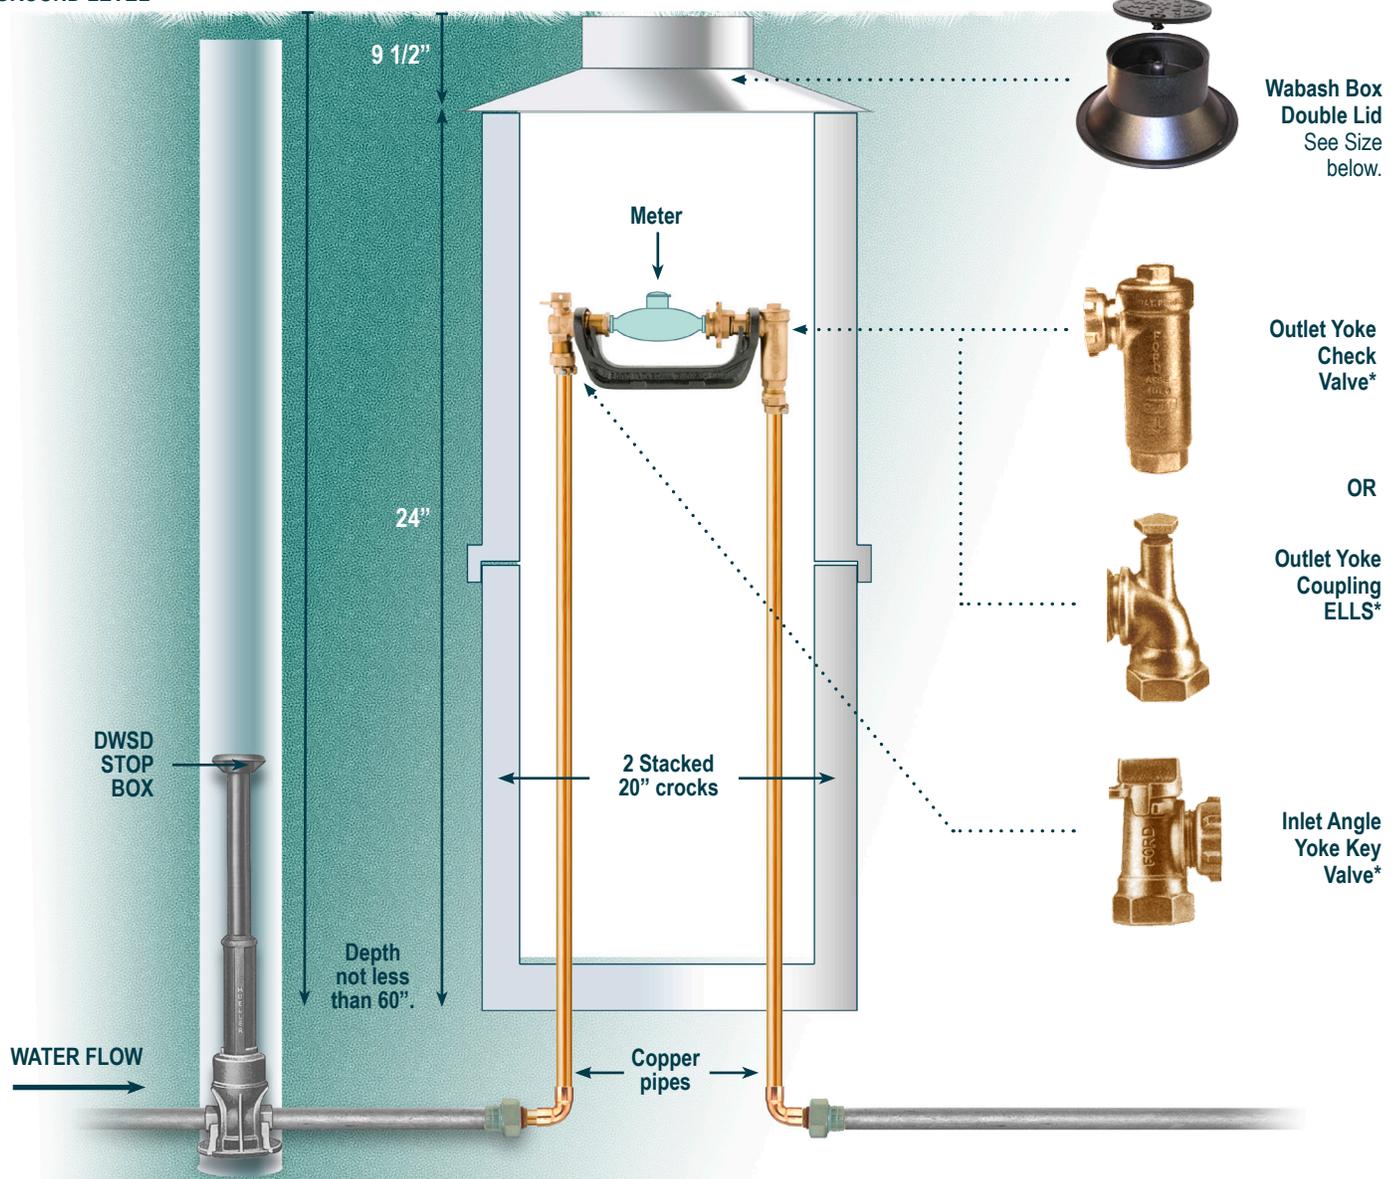

WABASH BOX

| METER | METER | VALVES | COUPLINGS |
|----------|---------------|--------------|--------------|
| 5/8 INCH | 7 1/2 INCHES | 3/4 INCH | 3/4 INCH |
| 3/4 INCH | 9 INCHES | 1 INCH | 1 INCH |
| 1 INCH | 10 3/4 INCHES | 1 1/4 INCHES | 1 1/4 INCHES |

The depth of the service line shall be installed below the lowest frost line. The heat generated from the soil at the base of the meter pit will circulate warm air and keep the service from freezing during winter.

*National Pipe Thread (NPT)

Please contact our Customer Care Center for questions or to schedule an appointment at **313-267-8000**.

