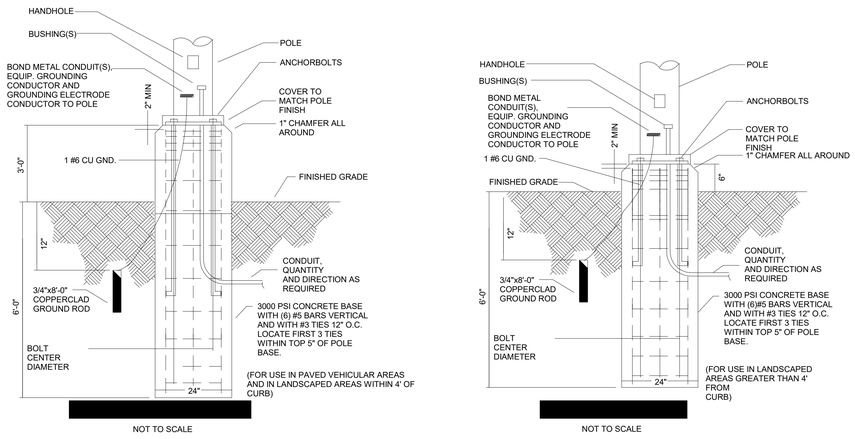

NOTES:
1. POLE BASE DEPTH BELOW GRADE AND REINFORCEMENT IS BASED ON A MAXIMUM POLE HEIGHT ABOVE GRADE OF 40'.
2. PROVIDE LEVELING NUTS AND NONSHRINK GROUT FOR ALL ANCHOR BOLTS. ALL BOLTS SHALL BE PROVIDED WITH LOCKNUTS UNDER BASE COVER.

1 SITE LIGHTING POLE DETAILS
E103 NOT TO SCALE

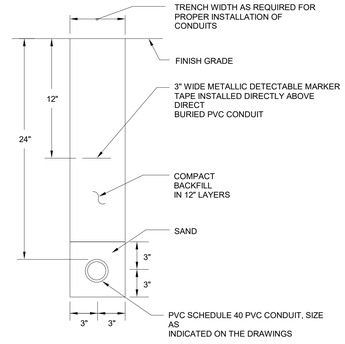

2 SITE LIGHTING CONDUIT DETAIL
E103 NOT TO SCALE

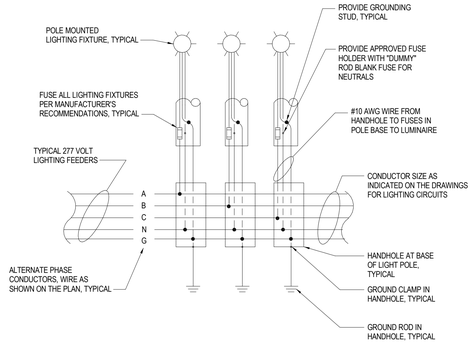

3 SITE LIGHTING WIRING DIAGRAM
E103 NOT TO SCALE

POLE MOUNTED FIXTURE
MULTIPLE HEAD CONFIGURATION
NOT TO SCALE

POLE MOUNTED FIXTURE
SINGLE HEAD CONFIGURATION
NOT TO SCALE

POLE MOUNTED
WALKWAY FIXTURE
NOT TO SCALE

WALL MOUNTED FIXTURE
NOT TO SCALE

4 SITE LIGHTING FIXTURE DETAILS
E103 NOT TO SCALE

Stantec
Stantec Architecture and Engineering LLC
650 Smithfield Street Suite 2500
Pittsburgh PA 15222-3900
Tel: (412) 394-7000 • www.stantec.com

The Contractor shall verify and be responsible for all dimensions. DO NOT scale the drawing. Any discrepancies shall be reported to the Consultant immediately. The Consultant is to all designs and drawings are the property of Stantec. Reproduction and use for any purpose whatsoever without permission in writing is strictly forbidden.

Consultant

No.	Issued/Revision	Date
1	ISSUED FOR PERMIT	2020.07.27
2	PERMIT SUBMISSION	2020.08.24

Permit/Seal

07/27/2020

Client/Project
Hillwood Development Company, Inc.

PROJECT PANDA - FULFILLMENT CENTER

Project No.:218011567

Scale: 12" = 1'-0"

DATE: 06.26.2020

Title
ELECTRICAL SITE DETAILS

Revision:

Drawing No.
E103

7/27/2020 2:39:03 PM

ORIGINAL SHEET - ARCH E1