



DATE OF LETTER _____

Dear DWSD Customer:

We were unable to complete your meter installation/repair due to an existing plumbing issue(s). It is urgent that you make the necessary repairs to avoid your water service being interrupted for non-compliance. Please reference the meter set-up diagram on the back of this letter as a guide.

Repairs must be completed and a follow-up appointment scheduled within ten (10) days of the date of this letter or your account will be interrupted for non-compliance.

REQUIRED REPAIR(S):

- Inlet valve, outlet valve and bypass operable (use gate valves only)
- Meter connection for inlet and outlet side flanged, if missing
- No corroded or leaking pipes, no PVC, braced piping is required
- Meter area accessible and clean
- Bypass valve operates (only applicable if service line is 1 ½" or larger)
- Piping aligned with correct meter spacing
- Proper meter well and cover (if applicable)
- Galvanized or copper set up
- Unwrap meter and service line
- Other _____

CAUTION Make sure repairs are performed correctly and according to instructions. Incorrect or incomplete repairs will delay meter work and perhaps lead to water service interruption.

REPAIRS If service needs to be turned off for repairs and/or restored after repairs have been completed, please call **313-267-7401** to make arrangements.

CONTACT Please contact our Customer Care Center to schedule an appointment at **313-267-8000**.

OR VISIT ONE OF OUR SERVICE CENTERS

Downtown Customer Care Center

735 Randolph Street
Detroit, MI 48226
Monday-Friday, 8 a.m.-5 p.m.

Eastside Customer Care Center

13303 E. McNichols Road
Detroit, MI 48205
Monday-Friday, 8 a.m.-5 p.m.

Westside Customer Care Center


15600 Grand River Avenue
Detroit, MI 48227
Monday-Friday, 8 a.m.-5 p.m.

Thank You,
The DWSD Meter Operations Team

IRRIGATION METER SET-UP REQUIREMENTS

No plastic permitted. Read before starting repair work.

IRRIGATION LARGE METER

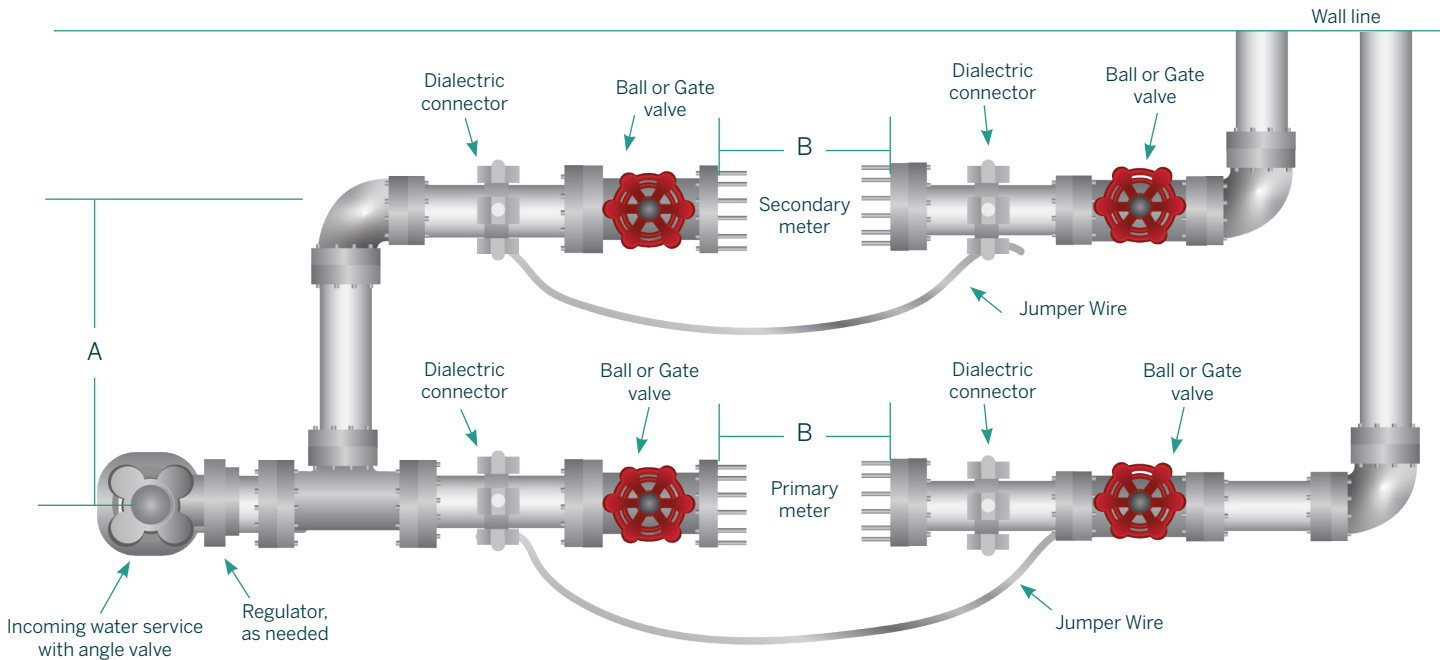

CUSTOMER IS RESPONSIBLE FOR MAINTAINING ALL PLUMBING IN ORDER FOR WORK TO BE PERFORMED.

Meter maintenance work cannot be performed if valves do not shut off, have handles, have leaks or if the pipe is corroded. You should periodically test the valves and check piping. Customers need properly operating valves any time the water has to be shut off to do internal plumbing repairs.

METER SIZE AND LENGTH MEASUREMENTS

METER / PIPE SIZE	A	B
3 INCH	28 INCHES	54 INCHES
4 INCH	32 INCHES	64 1/4 INCHES
6 INCH	36 INCHES	78 1/2 INCHES
8 INCH	44 INCHES	90 1/4 INCHES
10 INCH	52 INCHES	90 1/4 INCHES
12 INCH	60 INCHES	SEE NOTE

NOTE: The department of water supply will furnish and set the meter and such material included within dimension "B." For the 10" meter this dimension shall be secured from the DWSD meter shop at central yard located at 6425 Huber St.

METER SET-UP REQUIREMENTS

1. Must have total of 5 valves: ball or gate valves on each side of meter (typical).
2. Angle Valve with A34 adaptor.
3. For pressure regulated areas, install regulator immediately after angle valve but before tee
4. The secondary meter is for outdoor use charges only. The primary meter is for water/sewer use charges.